


NOTES

This map illustrates the approved substation location and its associated transmission line routes.


The approved 138 kV transmission lines require a 20m right-of-way where on private property. The approved 240 kV transmission lines require a 38m right-of-way where on private property. From E38-E35, the 138 kV transmission line will be located approximately 1m within the expanded road allowance.

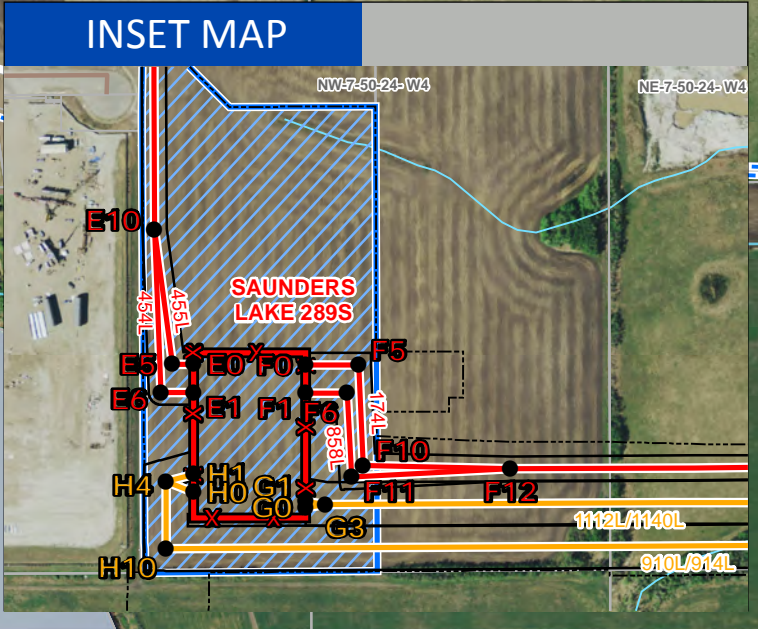

LEGEND

- Point Designation
- Approved Substation Upgrade
- Approved 138kV Transmission Line
- Approved 240kV Transmission Line
- Approved Salvaged Transmission Line
- - - Existing Transmission Line
- ⊠ Approved Substation Fenceline
- ▭ Approved Substation Site
- ▭ Approved Construction Workspace
- ▭ Right-of-Way Boundary
- Communication Tower
- Residence
- Pipeline
- Road
- ▭ Municipal or County Boundary
- Urban Area
- Water Body

NO: 35017014-6202
 DRAWN: MS - EBA
 FILE NO.: C22203149-03
 REVISION: 4.00.01
 AL FOLDER: Saunders Lake
DATE: 2016-08-08

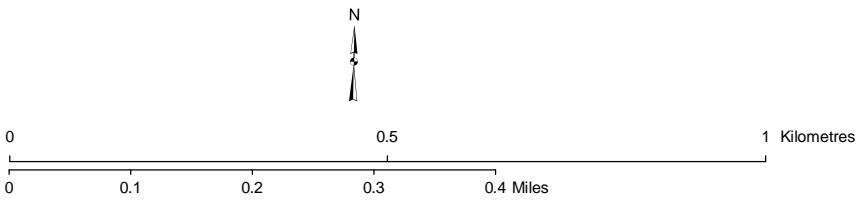

Although there is no reason to believe that there are any errors associated with the data used to generate this product or in the product itself, users of these data are advised that errors in the data may be present.
 Photography date: 2013 Source: Valtus Imagery Services 40cm Colour Ortho Photography

DETAIL PHOTO DP1



APPROVED
 South and West of Edmonton Area
 Transmission Development:

Preferred - Saunders Lake 289S Substation and Transmission Lines