


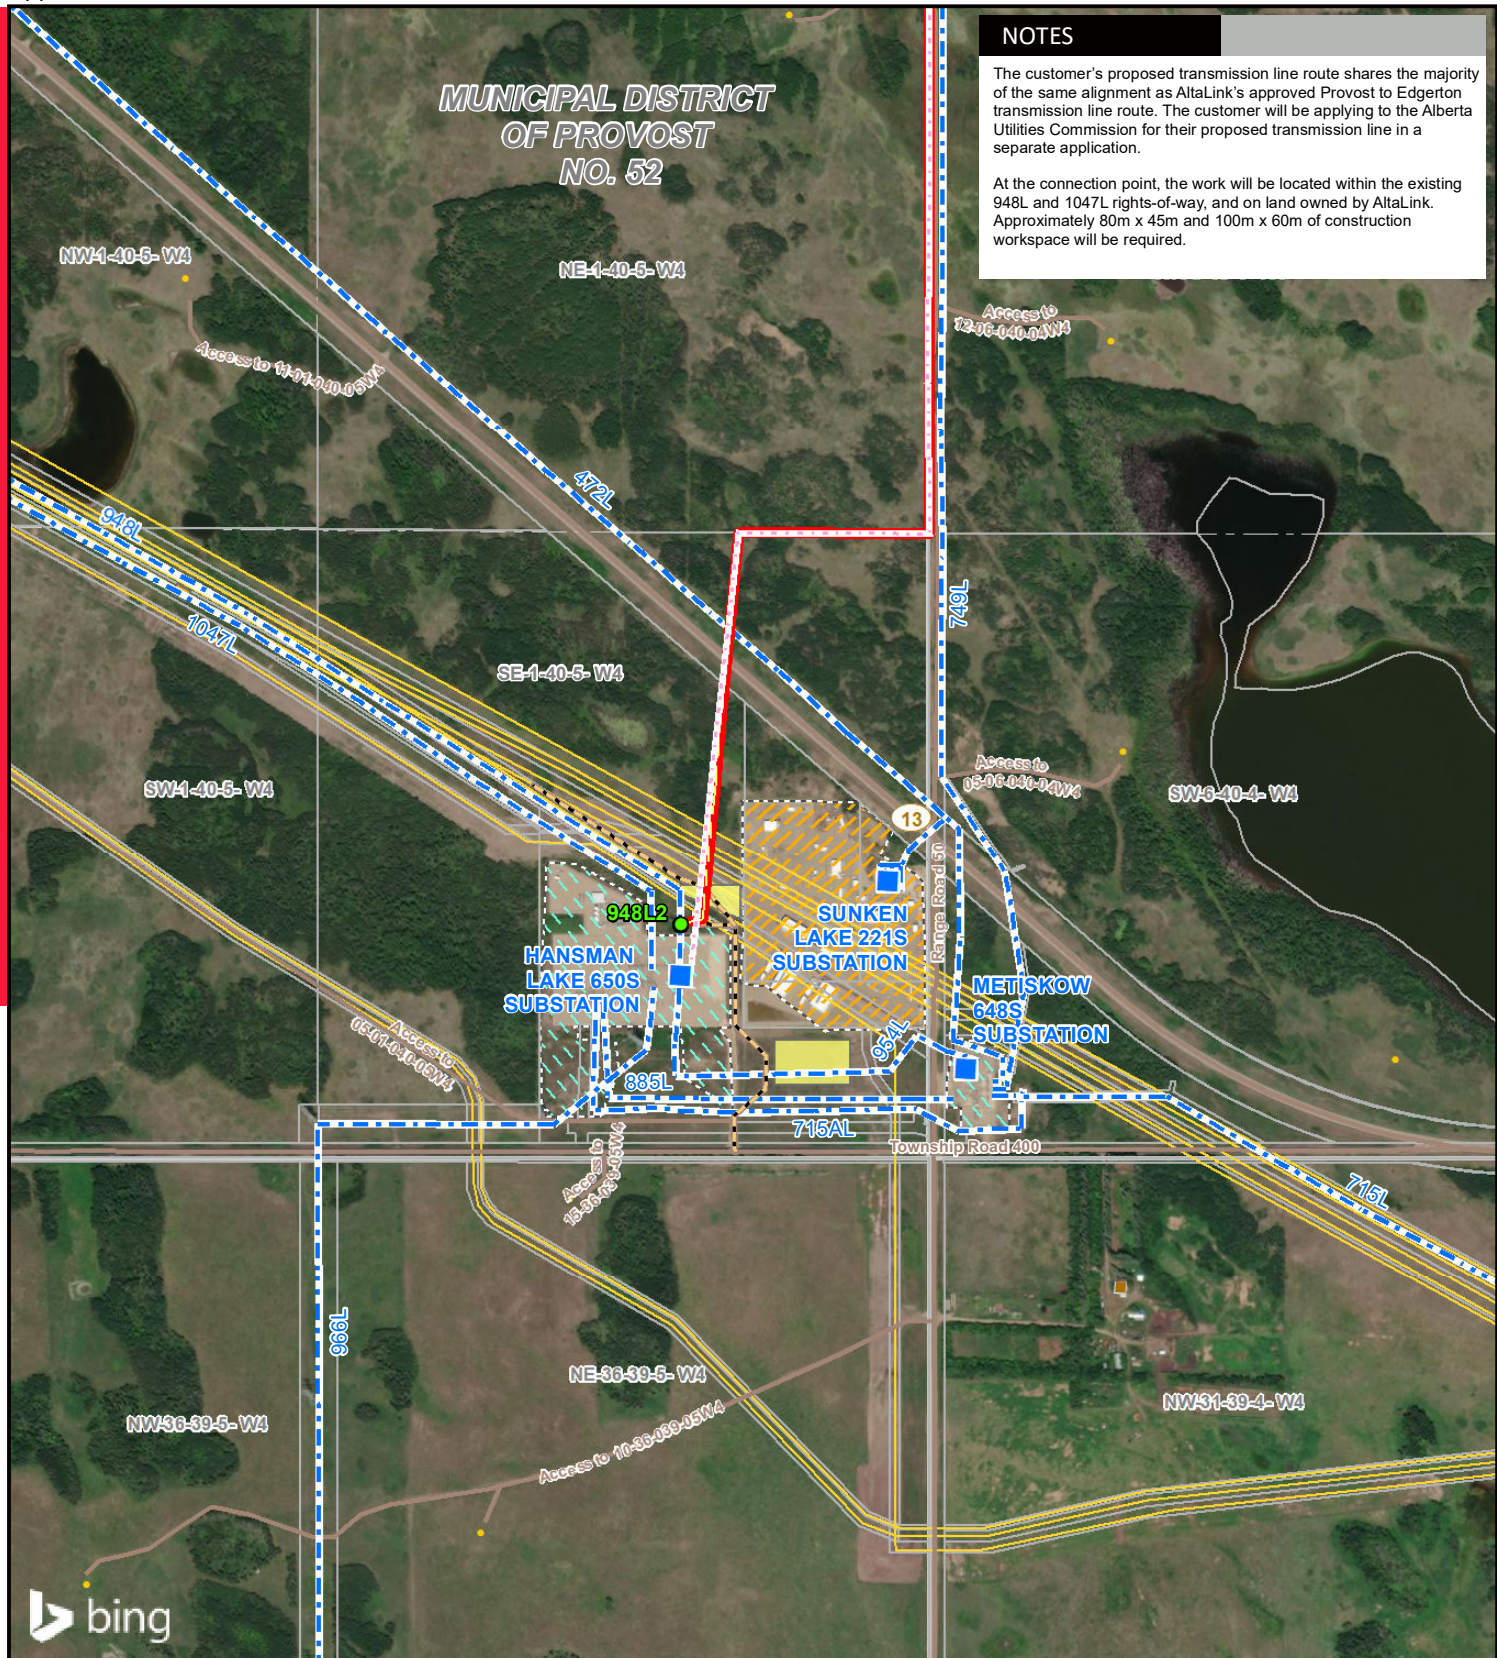

NOTES

The customer's proposed transmission line route shares the majority of the same alignment as AltaLink's approved Provost to Edgerton transmission line route. The customer will be applying to the Alberta Utilities Commission for their proposed transmission line in a separate application.

At the connection point, the work will be located within the existing 948L and 1047L rights-of-way, and on land owned by AltaLink. Approximately 80m x 45m and 100m x 60m of construction workspace will be required.

LEGEND

- | | | |
|--|---|--|
| ● Proposed Structure Replacement | ● Wellsite | OTHER ALTALINK PROJECTS IN THE AREA |
| ■ Existing Substation | — Pipeline | |
| — Proposed Customer Transmission Line | — Road | Approved Provost to Edgerton Transmission Line Route |
| - - - Existing Transmission Line | ■ Oil and Gas Plant | |
| — Access Trail | ■ Power Generation Station | |
| ■ Temporary Workspace | | |
| ■ Residence | | |

0 0.15 0.3 Kilometres
0 0.15 Miles



NO: 35034413 - 6201
DRAWN: SG - AL
FILE NO.: XXXXXXX
REVISION: 0.02.07
AL FOLDER: Dolcy Solar and Battery Connection
DATE: 2025-06-25

DETAIL PHOTO **DP1****PROPOSED**

**Dolcy Solar + Energy Storage
Project Connection**