


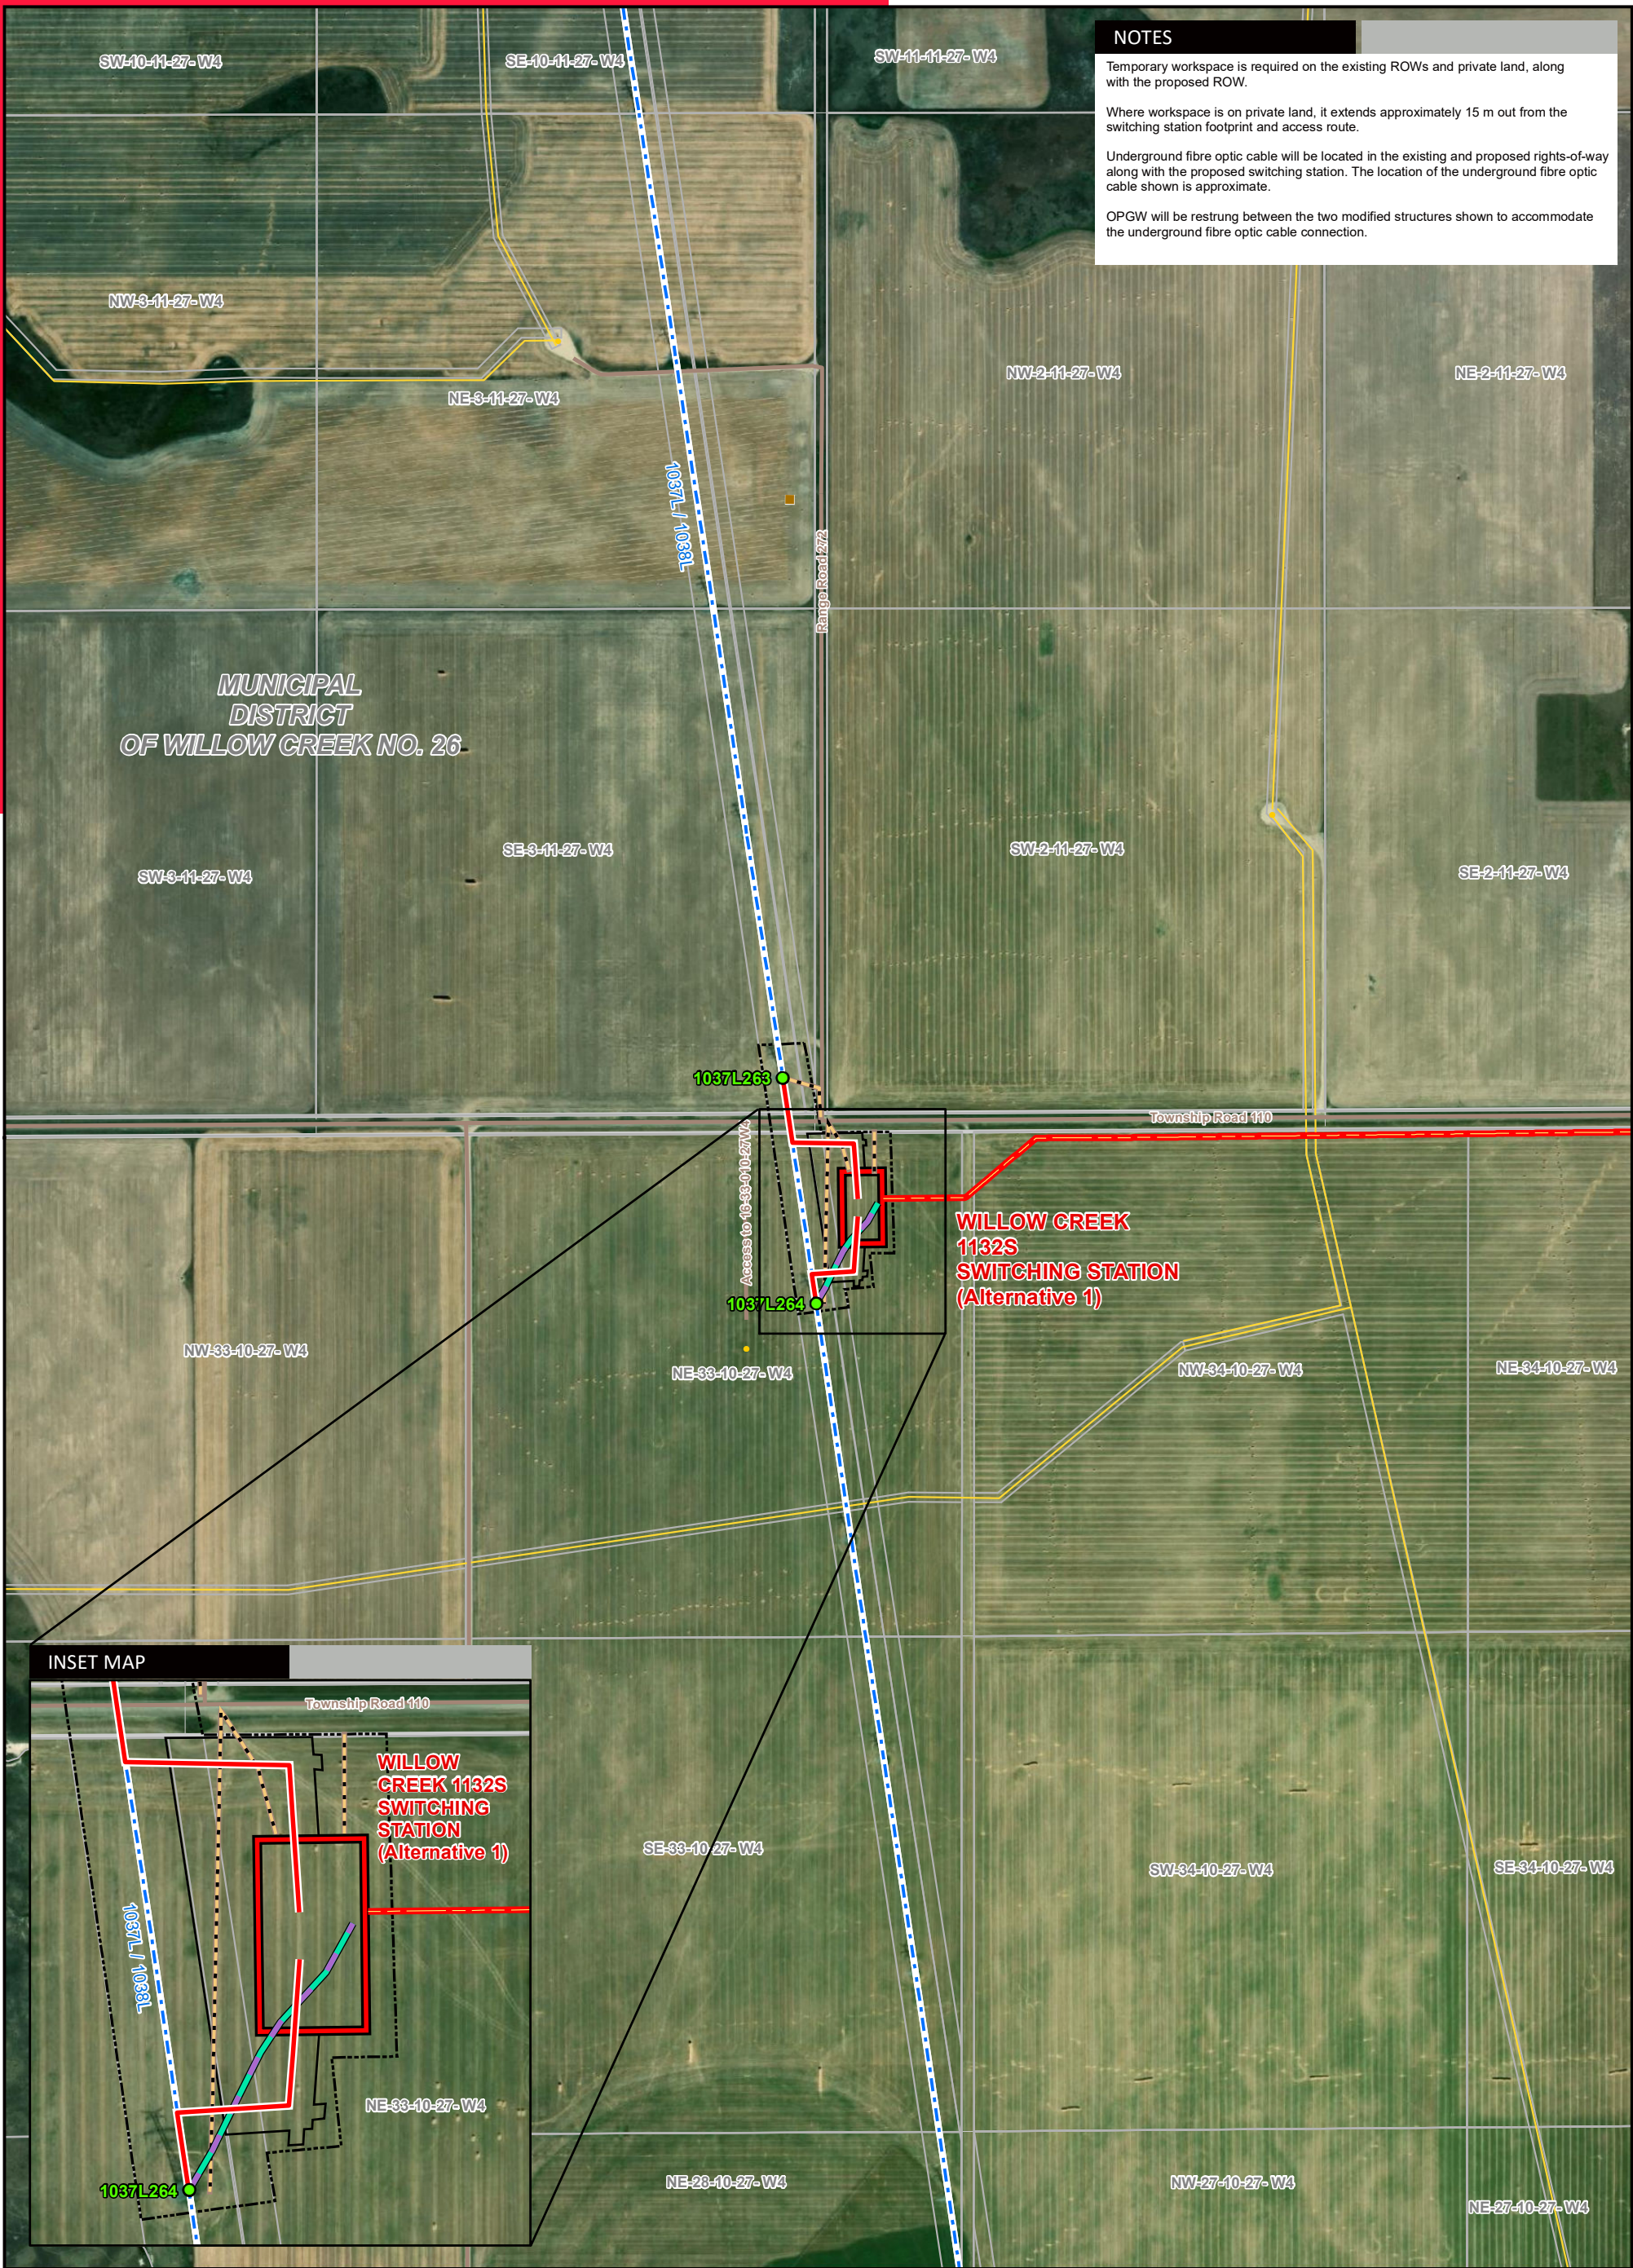


NOTES

Temporary workspace is required on the existing ROWs and private land, along with the proposed ROW.

Where workspace is on private land, it extends approximately 15 m out from the switching station footprint and access route.

Underground fibre optic cable will be located in the existing and proposed rights-of-way along with the proposed switching station. The location of the underground fibre optic cable shown is approximate.


OPGW will be restrung between the two modified structures shown to accommodate the underground fibre optic cable connection.

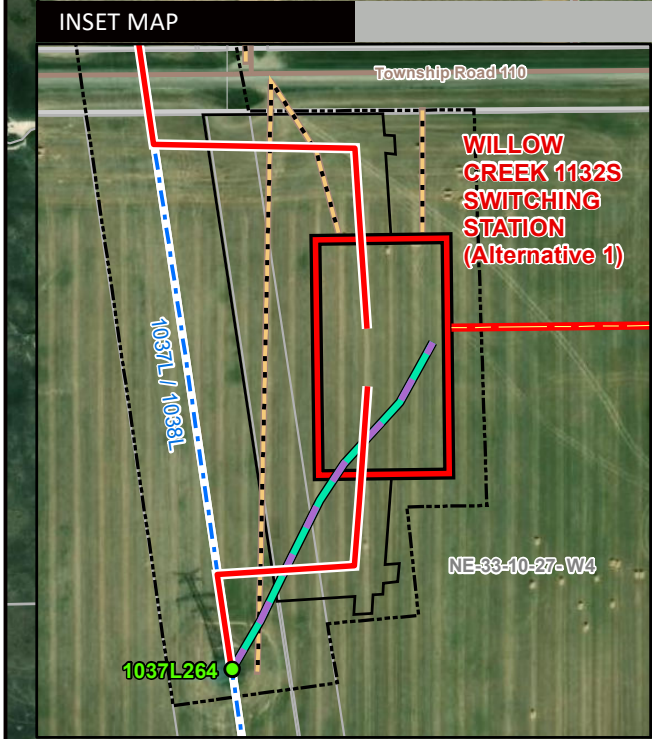

- LEGEND**
- Proposed Structure Modification
 - Proposed Transmission Line
 - Proposed Customer Transmission Line
 - Proposed Underground Fibre Optic Cable
 - Existing Transmission Line
 - Proposed Right of Way Boundary
 - Proposed Switching Station
 - Access Trail
 - Construction Workspace
 - Residence
 - Wellsite
 - Pipeline
 - Road

NO: 35035540 - 6201
DRAWN: SG - AL
FILE NO.: XXXXXX
REVISION: 0.00.03
AL FOLDER: Sweetgrass MPC
Solar Battery

DATE: 2025-07-02

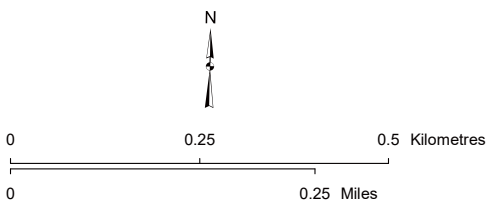

DETAIL PHOTO **DP1**



PROPOSED
Sweetgrass Solar And Energy
Storage Connection

Service Layer Credits: Source: Esri, Maxar, Earthstar Geographics, and the GIS User Community
Although there is no reason to believe that there are any errors associated with the data used to generate this product or in the product itself, users of these data are advised that errors in the data may be present.